

Prüfbescheinigung

Nr.: 2567/6389

Regensburg, 19. März 2007

Usage of 690V a.c. rated fuse-holders in a 700V d.c. photovoltaik application

Siemens fuseholders of size 14x51 (range 3NC1 49x and 3NC1 451-x) can be used in 700V d.c. photovoltaik applications due to the fact that these products are tested according the standard with 690V +5%.


To apply the fuseholder range 3NC1 49x as a switch-disconnector is forbidden stricly in that case of d.c. voltage.

Do not operate under load.

Siemens Aktiengesellschaft



Birkl

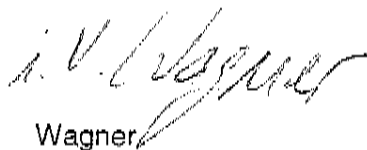

Wagner

Geschäftsgebiet Electrical Installation Technology

Leitung: Godehardt Schneider

Briefadresse: Siemens AG
CP PM

Name:
Seefeld, Volker

Telefon (0941) 790 - 01

Postfach 10 09 53
93009 Regensburg

Hausadresse:
Siemensstraße 10
93055 Regensburg

Durchwahl 2306
Fax (0941) 790 - 2227

Siemens Aktiengesellschaft · Vorsitzender des Aufsichtsrats: Heinrich v. Pierer · Vorstand: Klaus Kleinfeld, Vorsitzender
Johannes Feldmayer, Joe Kaeser, Rudi Lamprecht, Eduardo Montes, Jürgen Radomski, Erich R. Reinhardt,
Hermann Requardt, Uriel J. Sharaf, Klaus Wucherer
Sitz der Gesellschaft: Berlin und München · Registergericht: Berlin-Charlottenburg, HRB 12300; München, HRB 6684
WEEE-Reg.-Nr. DE 23691322